



—  
your partner  
in sensor  
technology.

# + Datasheet EE650

**Air Velocity Sensor for HVAC Applications**



# EE650

## Air Velocity Sensor for HVAC Applications

The EE650 air velocity sensor is designed for accurate and reliable measurement in building automation and ventilation applications.

### Innovative Design

The device employs an innovative air velocity sensing element, which operates on the thermal anemometer principle and is manufactured by E+E in state of the art thin-film technology. Due to its innovative design, the sensing element is very robust and highly insensitive to pollution, which leads to outstanding long-term performance.

### User Configuration

For the EE650 with analogue output, the measuring range 0...10/15/20 m/s (0...2000/3000/4000 ft/min), the output signal 4 - 20 mA or 0 - 10 V as well as the response time 1 or 4 seconds are selectable by jumpers.

The response time, the termination resistor and the bus address of the Modbus RTU version can also be easily set on the electronics board.

### Installation and Adjustment

The enclosure design and the mounting flange included in the scope of supply allow for fast and easy installation.

EE650 adjustment, output scale setting and interface parameter selection can be easily performed using the free PCS10 Product Configuration Software and an optional stick.



EE650 for duct mounting



EE650 with remote probe

# Features

## Bayonet screws

- Open / closed with a ¼ rotation

## Appropriate for US mounting requirements

- Knock-out for ½" conduit fitting

## External mounting holes

- Mounting with a closed cover
- Electronics protected against construction site pollution

## Enclosure

- IP65 / NEMA 4X

## Configuration and adjustment

- Measuring range
- Output signal
- Response time
- Bus address
- Termination resistor

## Electronics on the underside of the PCB

- Protection against mechanical damage during installation



## E+E air velocity sensing element

- Exceptional mechanical stability thanks to transfer-moulding technology
- High insensitivity to pollution
- Long-term stable
- Measurement down to 0.2 m/s (40 ft/min)

## Test report

according to DIN EN 10204-2.2

# Features

## Accredited Traceable Calibration Certificate



Internationally recognised certificates for the calibration of measuring instruments from accredited laboratories document the traceability of the measurements to the International System of Units (SI). The E+E Elektronik calibration laboratory offers two levels of traceable calibrations.

- As a Designated Institute (DI) of the Republic of Austria, the E+E calibration laboratory maintains Austria's national measurement standards for humidity, dew point temperature, air velocity and CO<sub>2</sub>. This authorises the E+E calibration laboratory to issue calibration certificates at the level of a National Metrological Institute (NMI).
- The E+E calibration laboratory is accredited by Akkreditierung Austria in accordance with DIN EN ISO/IEC 17025 with the identification number 0608. This allows the laboratory to issue ISO 17025 certificates for the measurands humidity, temperature, dew point temperature, air velocity, flow, pressure and CO<sub>2</sub>.

Visit [www.eplusecal.com](http://www.eplusecal.com) for detailed information on calibration and to enquire a certificate of accredited traceable calibration for the EE650 from the Designated Institute.

## ISO 9001 Calibration Certificate


An ISO 9001 calibration certificate documents the comparative measurement of a device against high quality reference equipment (factory level standard). The comparison is performed in accordance with internal procedures that comply with ISO 9001 and provides information on the specimen's measuring accuracy. The reference equipment is traceable to national standards, however, the calibration process is not accredited. Therefore, an ISO 9001 calibration is neither traceable nor internationally comparable.

Visit [www.epluse.com/iso9001cal](http://www.epluse.com/iso9001cal) for detailed information on calibration and to enquire an ISO 9001 calibration certificate.


# Dimensions

Values in mm (inch)


## Duct mount

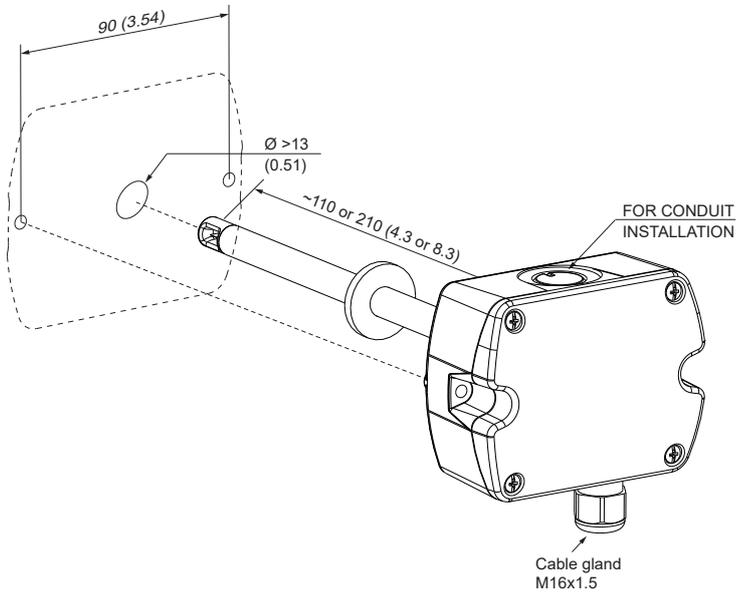

## Remote probe

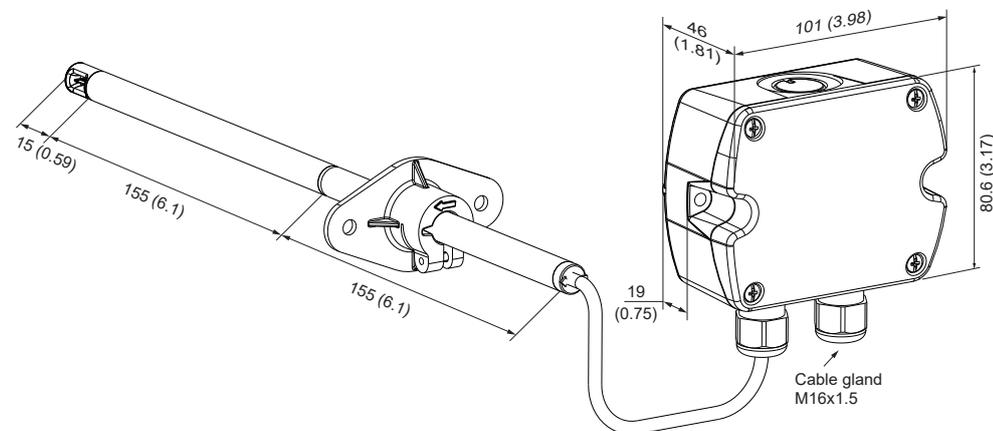

## Mounting flange

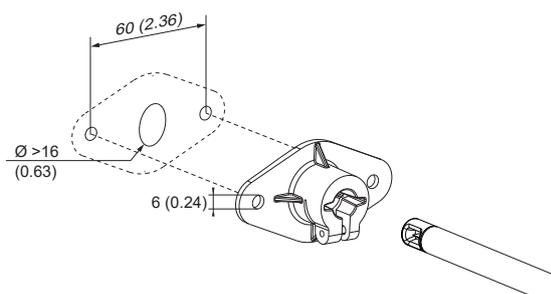

# Technical Data

## Measurands

### Air Velocity (v)

<b>Measuring range</b>	0...10 m/s (0...2000 ft/min) 0...15 m/s (0...3000 ft/min) 0...20 m/s (0...4000 ft/min) (factory setting)
<b>Accuracy<sup>1)</sup></b> from 0.2 m/s, @ 20 °C (68 °F), 45 %RH and 1013 hPa (14.7 psi)	±(0.2 m/s (40 ft/min) + 3 % of m. v.) <span style="float: right;">mv = measured value</span>
<b>Response time t<sub>90</sub></b> , typ. @ constant temperature, selectable via jumpers, only for analogue output	4 s (factory setting) down to 1 s

1) The accuracy statement includes the uncertainty of the factory calibration with a coverage factor k=2 (2-times standard deviation).  
The accuracy was calculated in accordance with EA-4/02 and with regard to GUM (Guide to the Expression of Uncertainty in Measurement).

## Outputs

### Analogue

<b>Air velocity v</b> measuring range selectable via jumpers, only for analogue output	0 - 10 V 4 - 20 mA (3-wire, factory setting)	0 < I <sub>L</sub> < 1 mA R <sub>L</sub> ≤ 500 Ω	I <sub>L</sub> = load current R <sub>L</sub> = load resistance
---	---	---	---

### Digital

<b>Digital interface</b>	RS485 (EE650 = 1 unit load)
<b>Protocol</b> <b>Factory settings</b> <b>Supported Baud rates</b> <b>Measured data types</b>	Modbus RTU 9600 Baud, parity even, 1 stop bit, Modbus address 65 9600, 19200 and 38400 FLOAT32 and INT16

## General

<b>Power supply</b> class III  USA & Canada: Class 2 supply necessary	24 V AC/DC ±20 %		
<b>Current consumption</b> , max.	<b>AC supply</b>	<b>DC supply</b>	
	<b>Analogue output</b>	170 mA	70 mA
	<b>RS485</b>	120 mA	50 mA
<b>Electrical connection</b>	Screw terminals max. 1.5 mm <sup>2</sup> (AWG 16)		
<b>Cable gland</b>	M16x1.5		
<b>Humidity working range</b>	5...95 %RH, non-condensing		
<b>Temperature working range</b>	<b>Probe</b>	-25...+50 °C (-13...+122 °F)	
	<b>Electronics</b>	-10...+50 °C (+14...+122 °F)	
	<b>Storage</b>	-30...+60 °C (-22...+140 °F)	
<b>Enclosure material</b>	PC (Polycarbonate), UL94V-0 approved		
<b>Protection rating</b>	<b>Enclosure</b>	IP65/NEMA 4X	
	<b>Remote probe</b>	IP20	
<b>Electromagnetic compatibility</b>	EN 61326-1 FCC Part15 Class B	EN 61326-2-3 ICES-003 Class B	Industrial environment
<b>Conformity</b>	 		

# Ordering Guide

Feature	Description	Code		
		<b>EE650-</b>		
Hardware Configuration	Type	Duct mount	<b>T2</b>	
		Remote probe	<b>T3</b>	
	Output	4 - 20 mA (changeable to 0 - 10 V via jumper)	<b>A6</b>	<b>A6</b>
		RS485	<b>J3</b>	<b>J3</b>
	Probe length	100 mm (3.94")	<b>L100</b>	
		200 mm (7.87")	<b>L200</b>	
		300 mm (11.81") (2 x 150 mm) (2 x 5.91")		<b>L300</b>
	Probe cable length	Not applicable	<b>No code</b>	
		1 m (3.3 ft)		<b>K1</b>
		2 m (6.6 ft)		<b>K2</b>
5 m (16.4 ft)			<b>K5</b>	
10 m (32.8 ft)			<b>K10</b>	
Digital Interface	Protocol	Modbus RTU <sup>1)</sup>	<b>P1</b>	
	Baud rate	9600	<b>BD5</b>	
		19200	<b>BD6</b>	
38400		<b>BD7</b>		
Accredited Traceable Calibration Certificate in accordance with DIN EN ISO/IEC 17025		see <a href="http://www.epluseca.com">www.epluseca.com</a>		
ISO 9001 Calibration Certificate		see <a href="http://www.epluse.com/iso9001cal">www.epluse.com/iso9001cal</a>		

1) Factory setting: parity even, 1 stop bit, Modbus Map see User Manual at [www.epluse.com/ee650](http://www.epluse.com/ee650).

## Order Examples

### EE650-T2J3L200P1BD5

Feature	Code	Description
Type	<b>T2</b>	Duct mount
Output	<b>J3</b>	RS485
Probe length	<b>L200</b>	200 mm (7.87")
Protocol	<b>P1</b>	Modbus RTU
Baud rate	<b>BD5</b>	9600


### EE650-T3A6L300K2

Feature	Code	Description
Type	<b>T3</b>	Remote probe
Output	<b>A6</b>	4 - 20 mA
Probe length	<b>L300</b>	300 mm (11.81"), (2 x 150 mm) (2 x 5.91")
Probe cable length	<b>K2</b>	2 m (6.6 ft)

# Accessories

For further information refer to the [Accessories](#) datasheet.

Accessories	Code
USB-C configuration stick	HA011070
PCS10 Product Configuration Software (free download: <a href="http://www.epluse.com/configurator">www.epluse.com/configurator</a> )	PCS10
Power supply adapter 24 V DC	V03

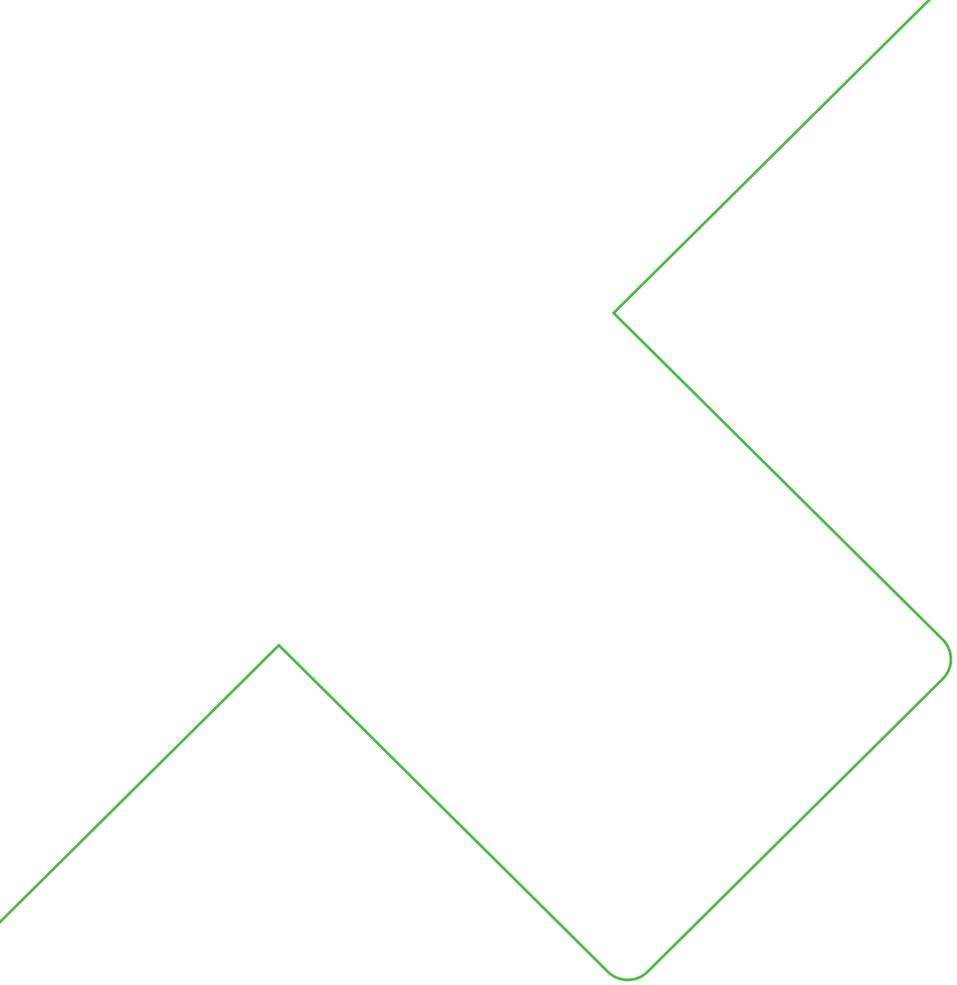

Company Headquarters &  
Production Site

**E+E Elektronik Ges.m.b.H.**  
Langwiesen 7  
4209 Engerwitzdorf | Austria  
T +43 7235 605-0  
F +43 7235 605-8  
info@epluse.com  
www.epluse.com

Subsidiaries

**E+E Sensor Technology (Shanghai) Co., Ltd.**  
T +86 21 6117 6129  
info@epluse.cn

**E+E Elektronik France SARL**  
T +33 4 74 72 35 82  
info.fr@epluse.com

**E+E Elektronik Deutschland GmbH**  
T +49 6171 69411-0  
info.de@epluse.com

**E+E Elektronik India Private Limited**  
T +91 990 440 5400  
info.in@epluse.com

**E+E Elektronik Italia S.r.l.**  
T +39 02 2707 86 36  
info.it@epluse.com

**E+E Elektronik Korea Ltd.**  
T +82 31 732 6050  
info.kr@epluse.com

**E+E Elektronik Corporation**  
T +1 847 490 0520  
info.us@epluse.com



—  
your partner  
in sensor  
technology.